




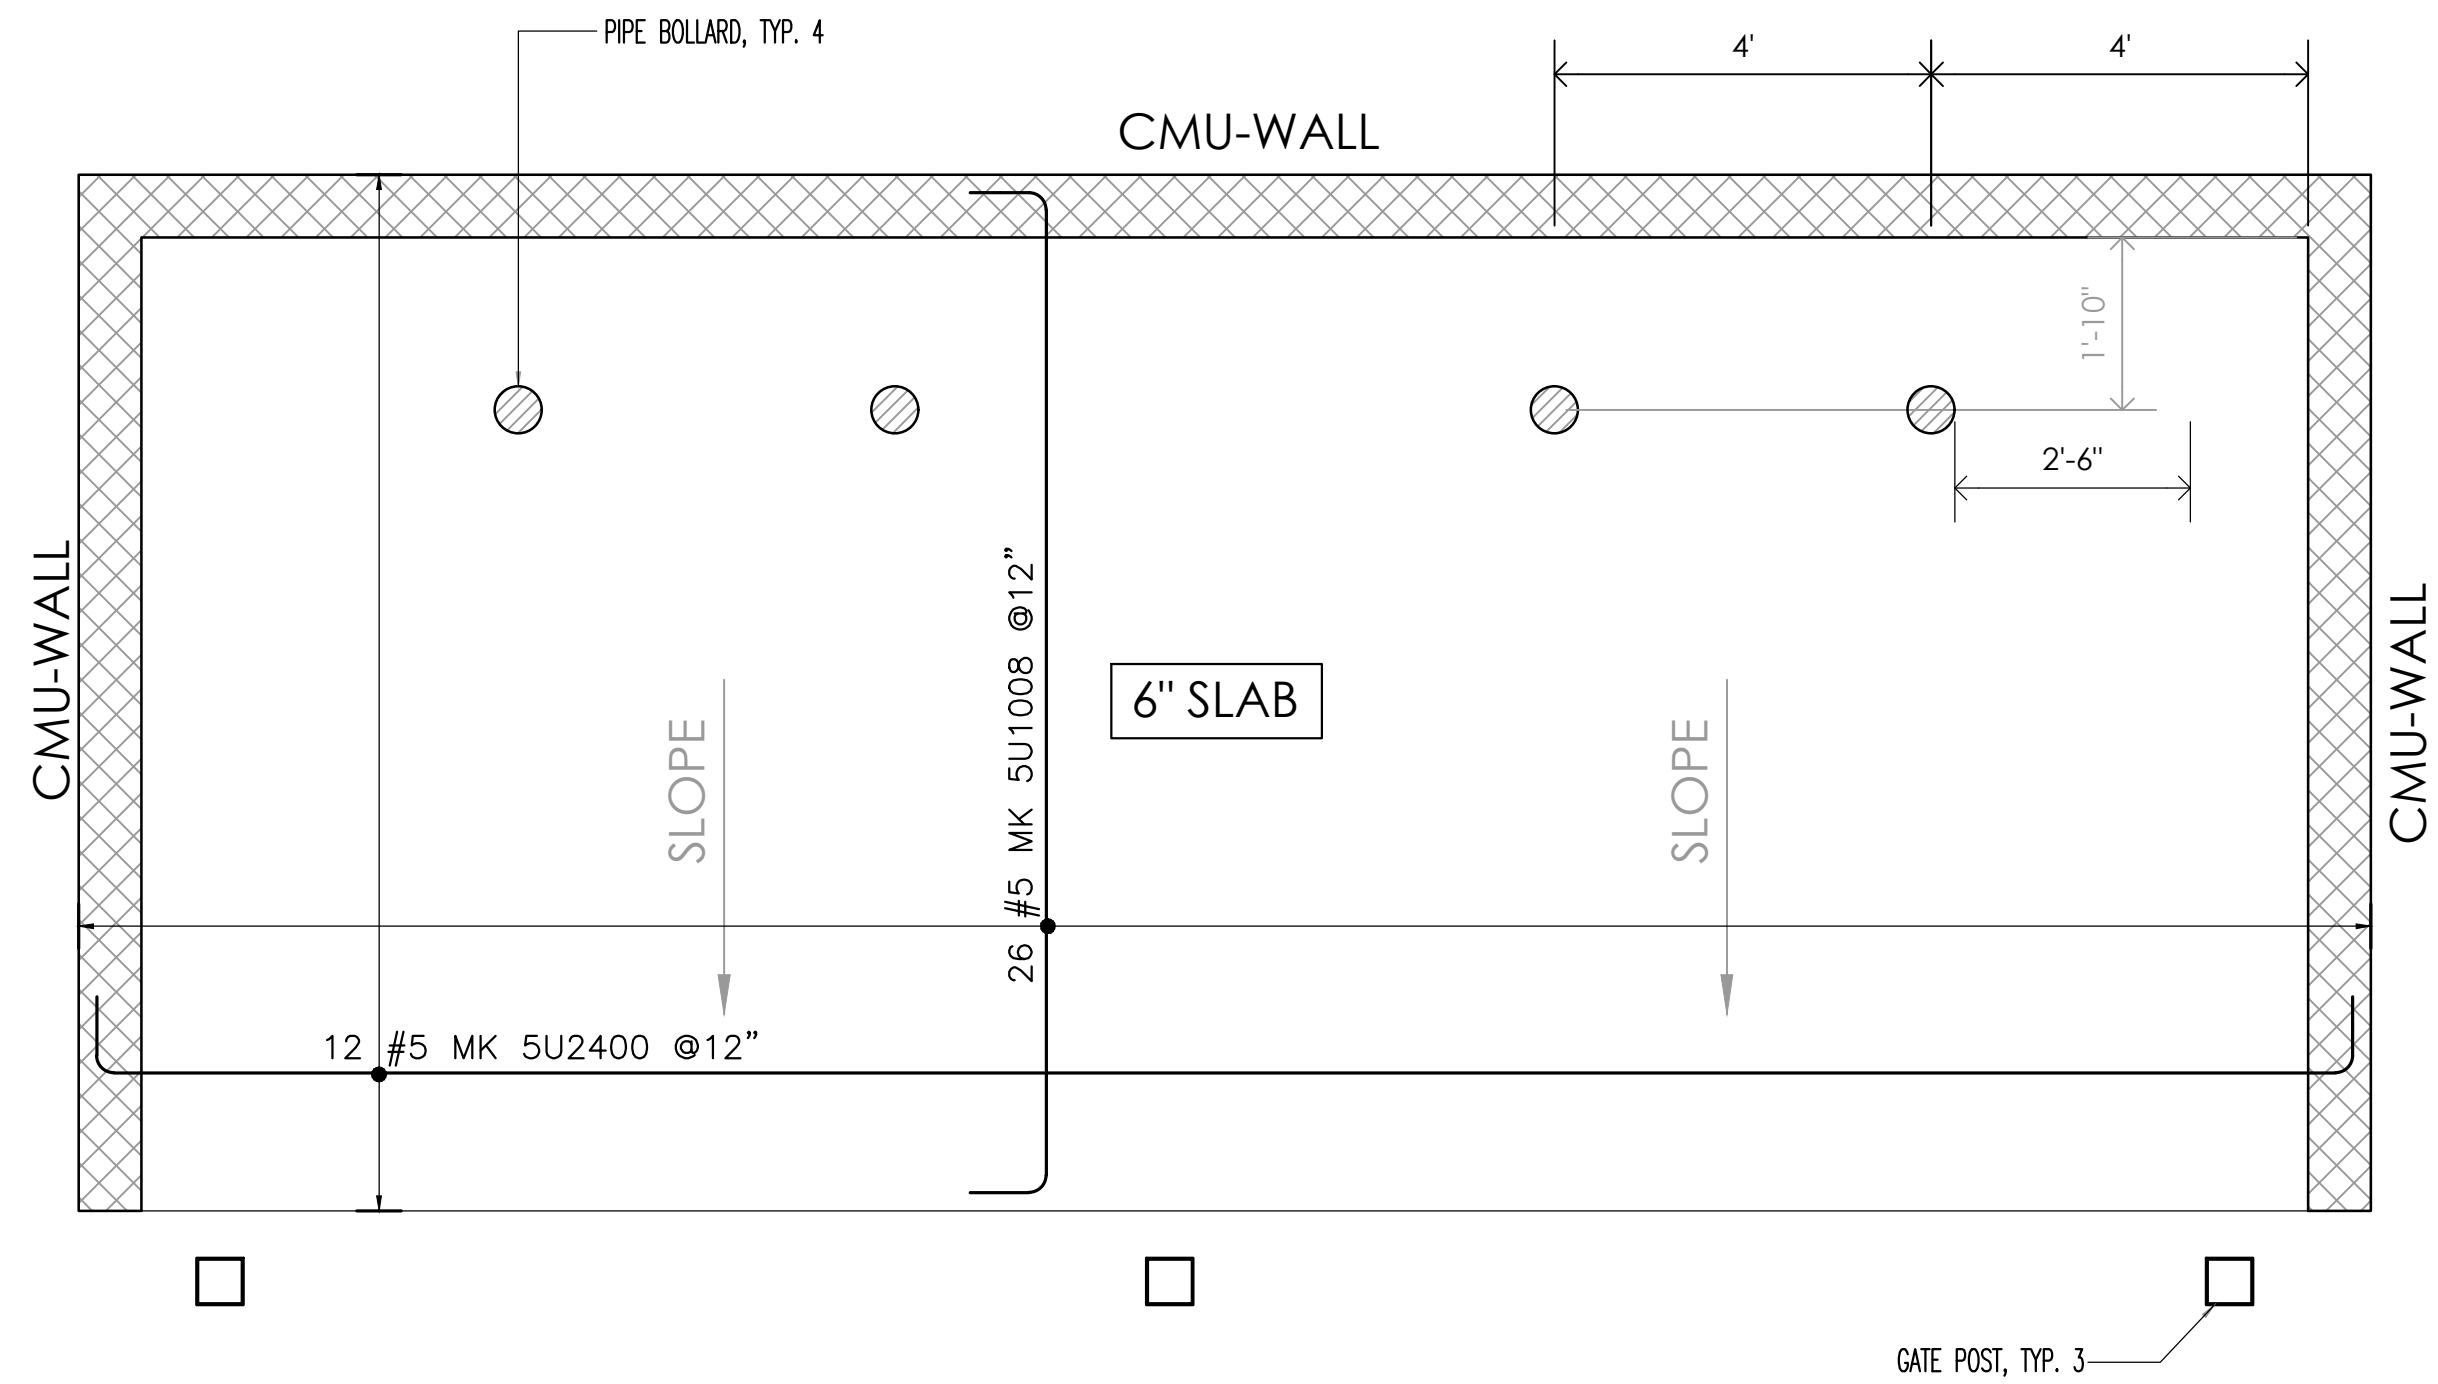


TRASH ENCLOSURE
SLAB REINFORCEMENT

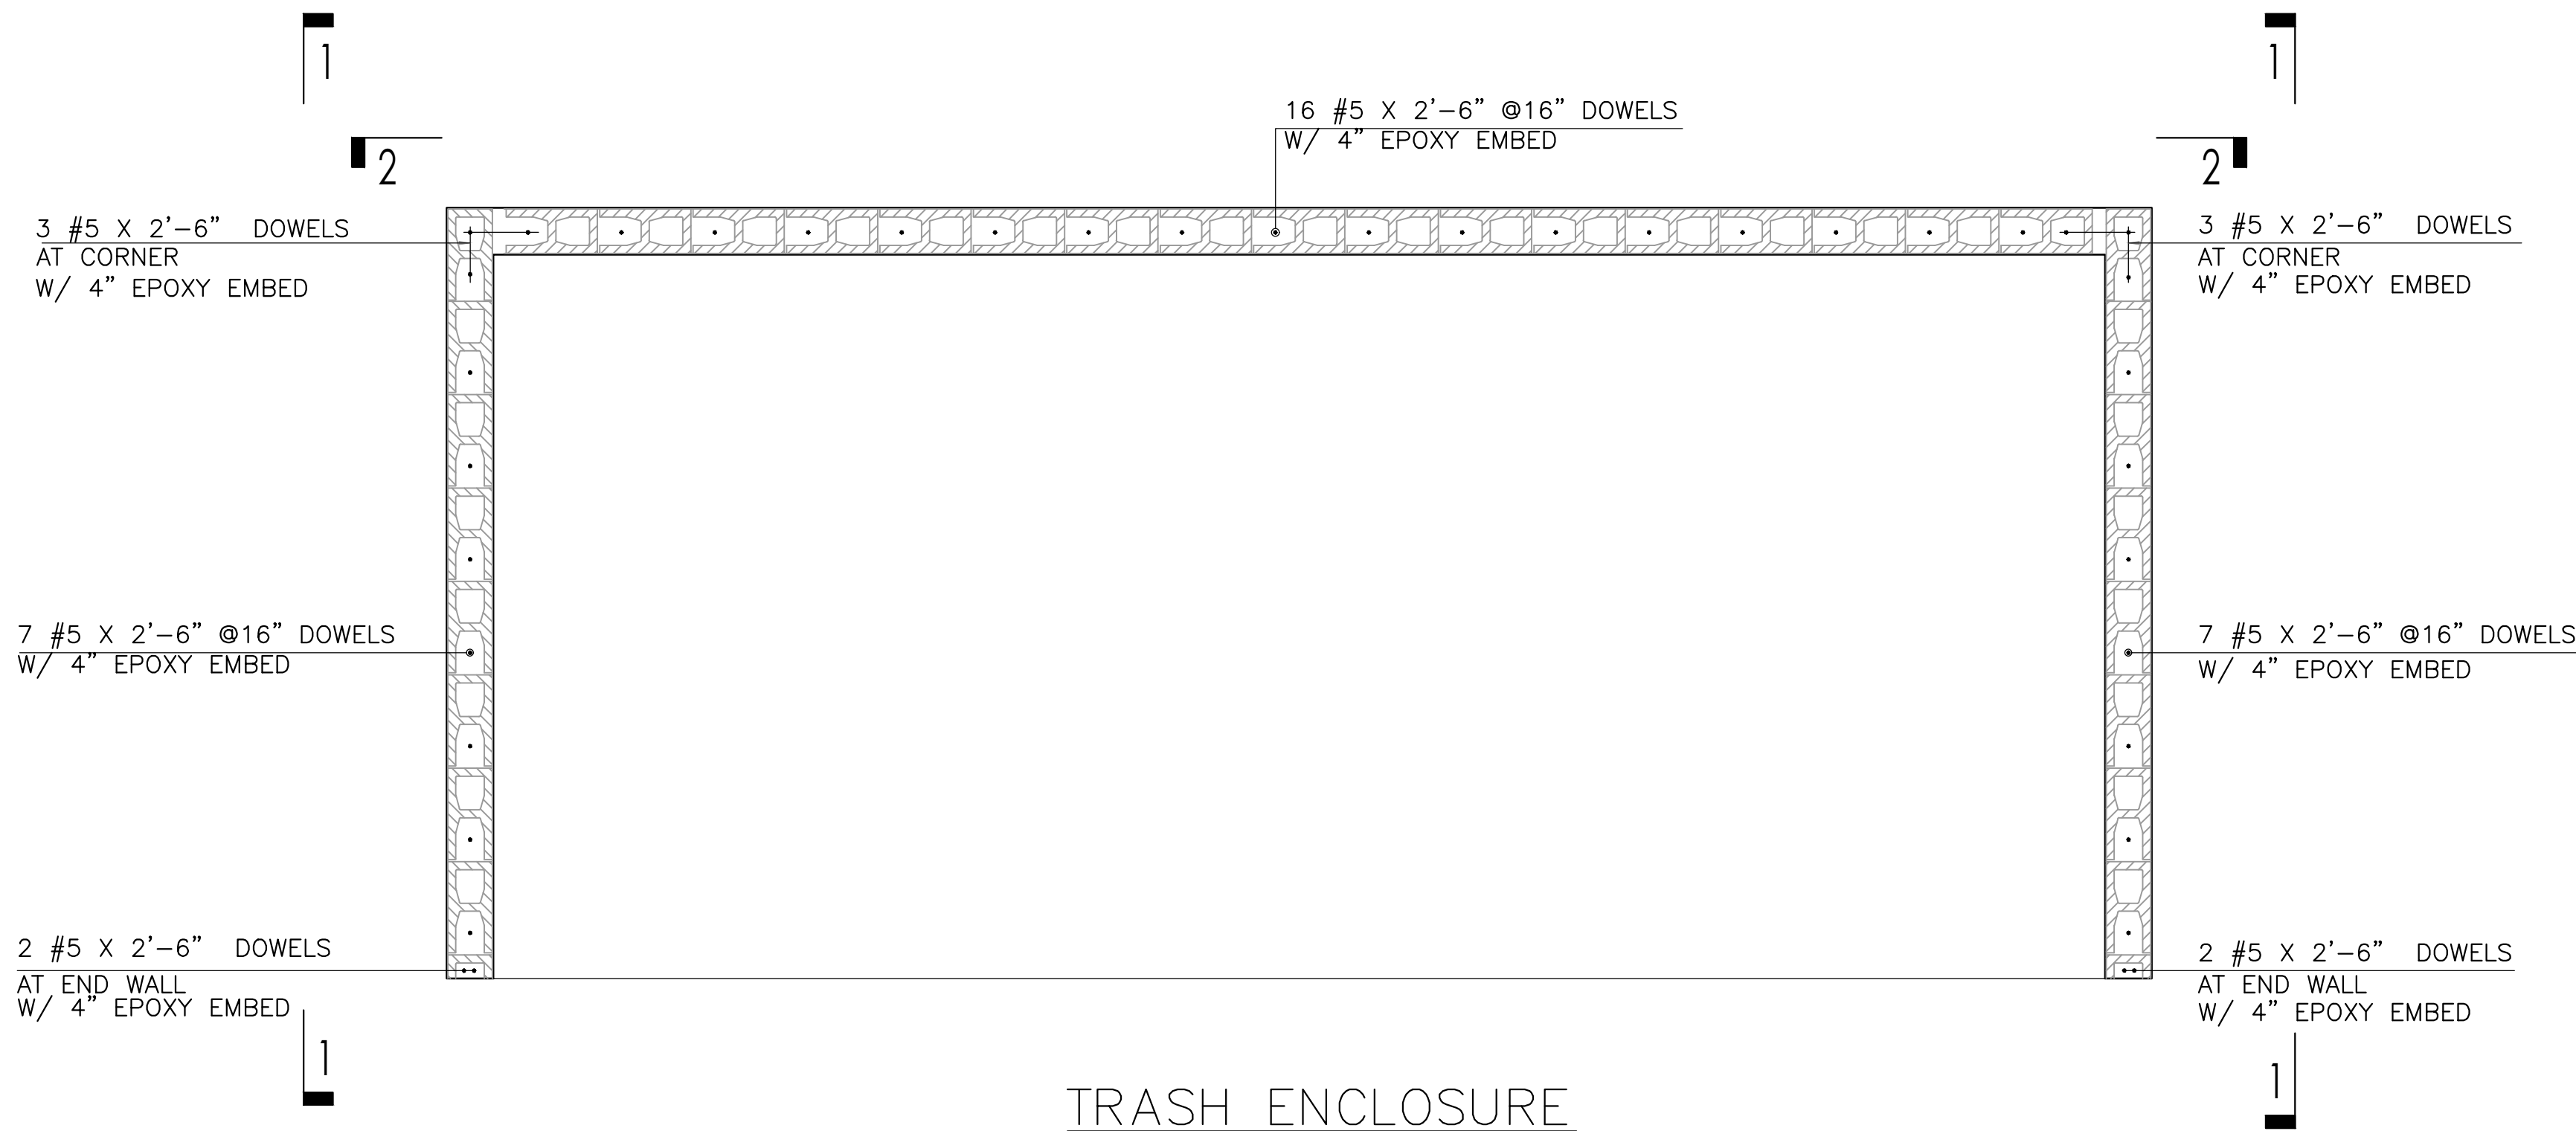


TRASH ENCLOSURE
WALL REINFORCEMENT

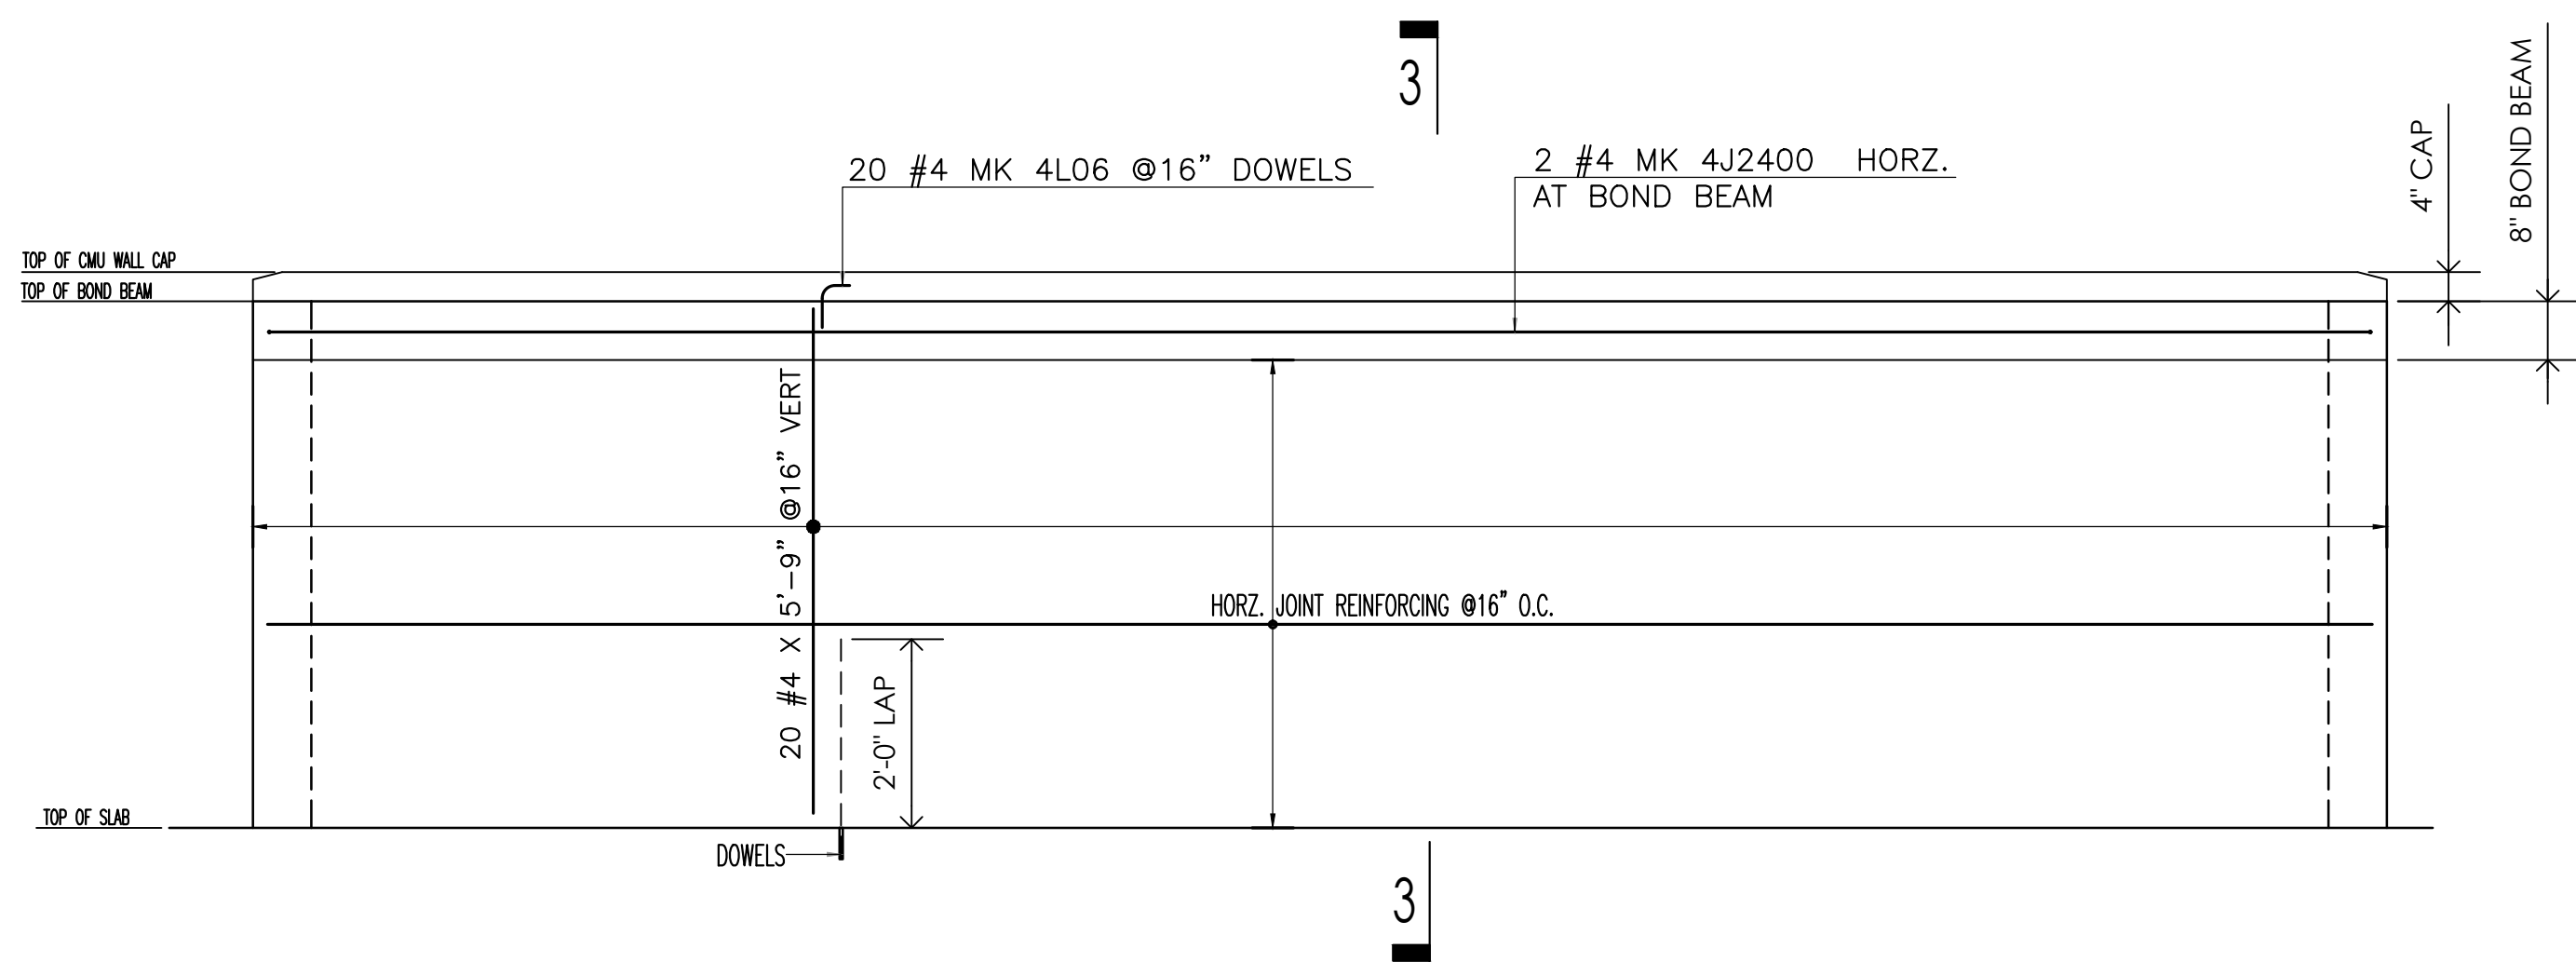

ELEVATION 2-2

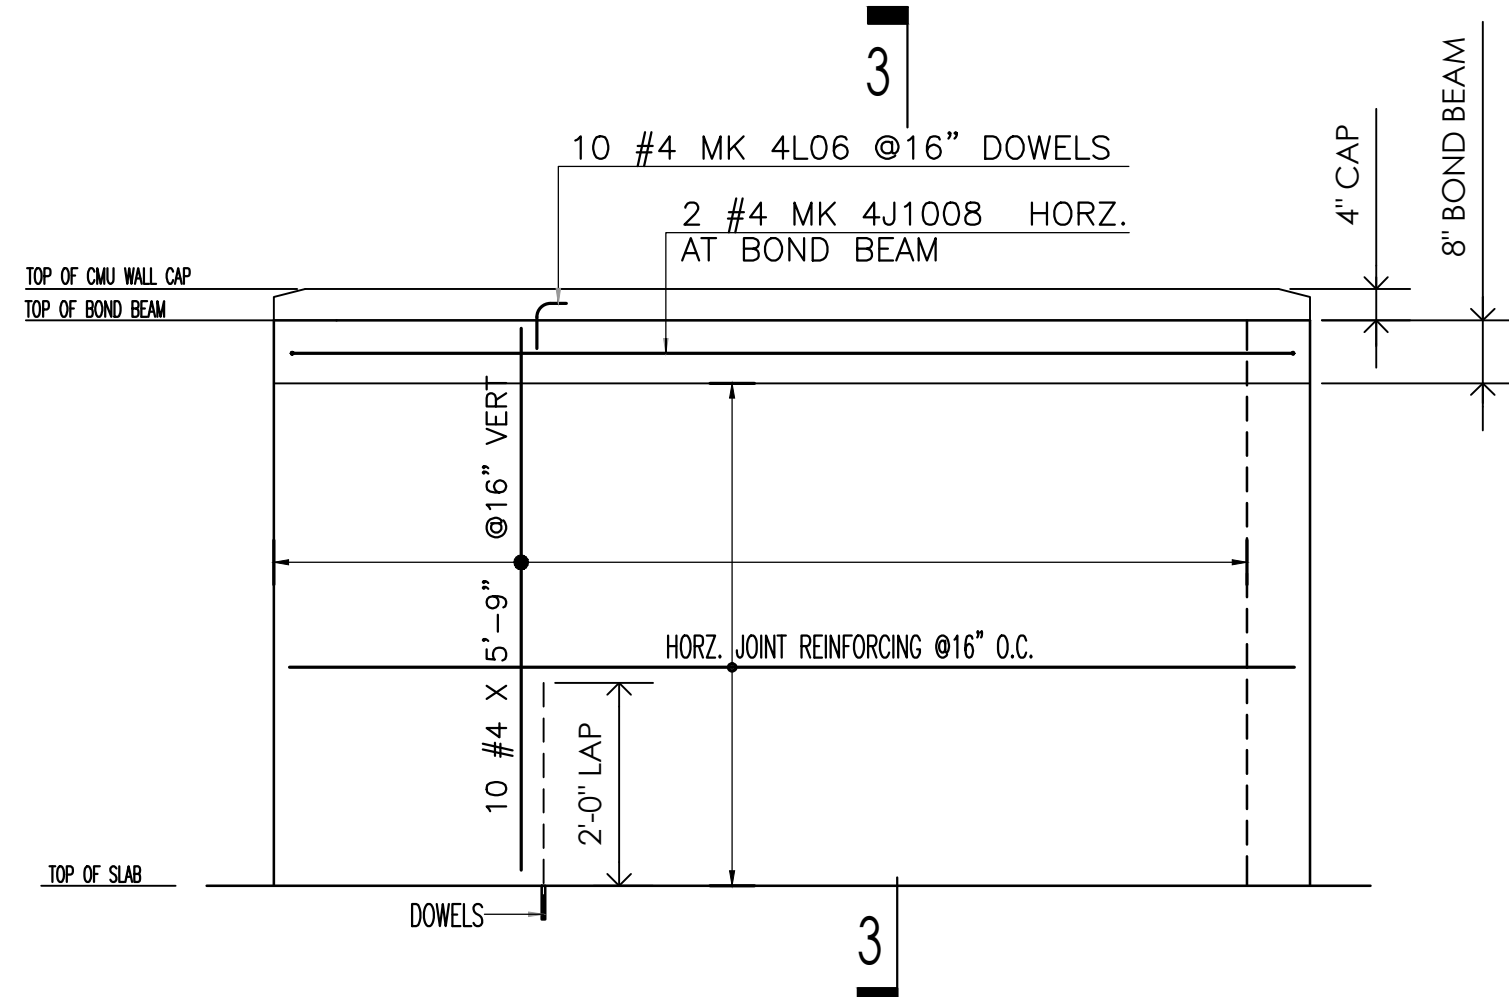


ELEVATION 1-1
TYPICAL IN TWO LOCATIONS

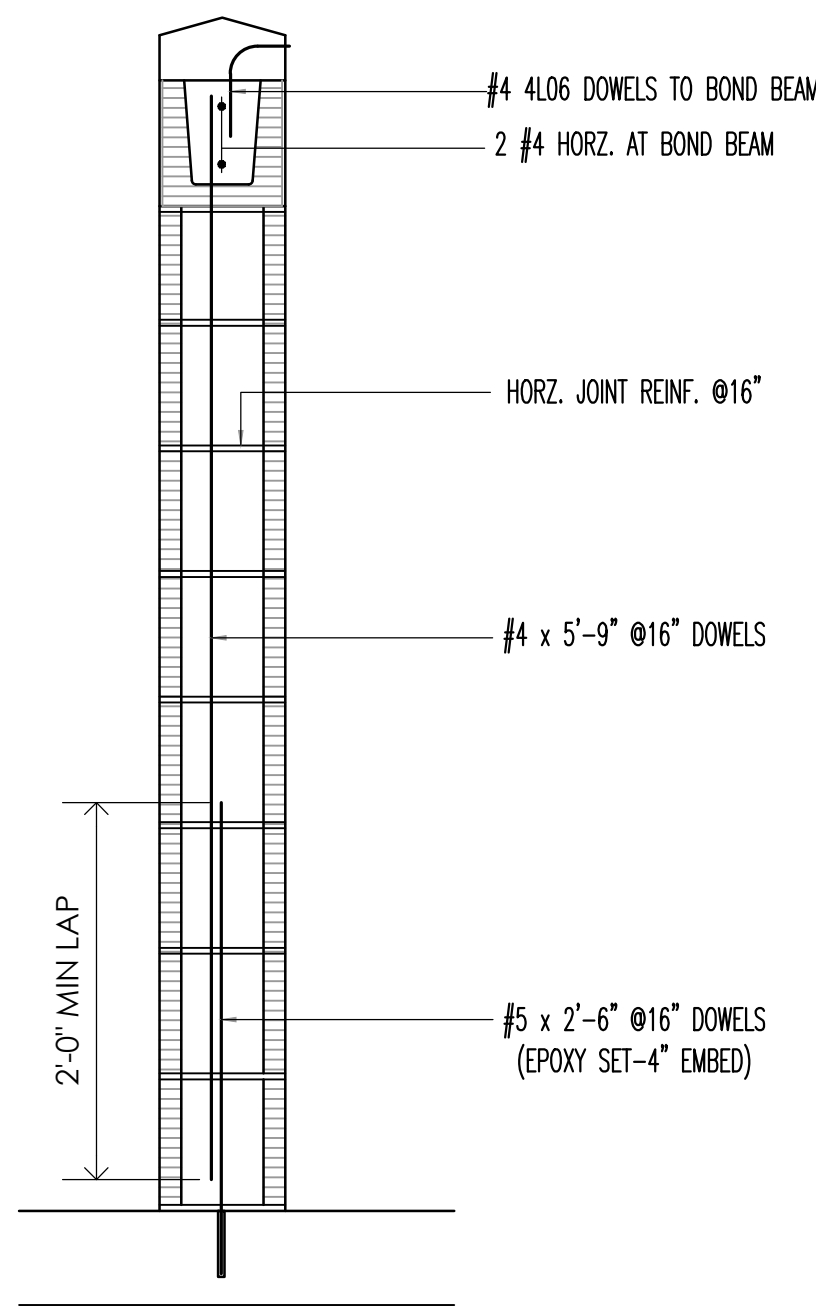

ELEVATION 3-3, TYP

Release Number:				BAR LIST												
Bar Mark	Qty	Size	Total Length	Type	'A'	'B'	'C'	'D'	'E'	'F'	'G'	'H'	'J'	'K'	'O'	'R'
4J2400	2	#4	25'-0"	1	0'-6"	24'-0"					0'-6"		0'-4"			
4J1008	2	#4	11'-8"	1	0'-6"	10'-8"					0'-6"		0'-4"			
5U2400	12	#5	25'-8"	2	0'-10"	24'-0"					0'-10"					
5U1008	26	#5	12'-4"	2	0'-10"	10'-8"					0'-10"					
4L06	30	#4	0'-10"	17		0'-4"	0'-6"									

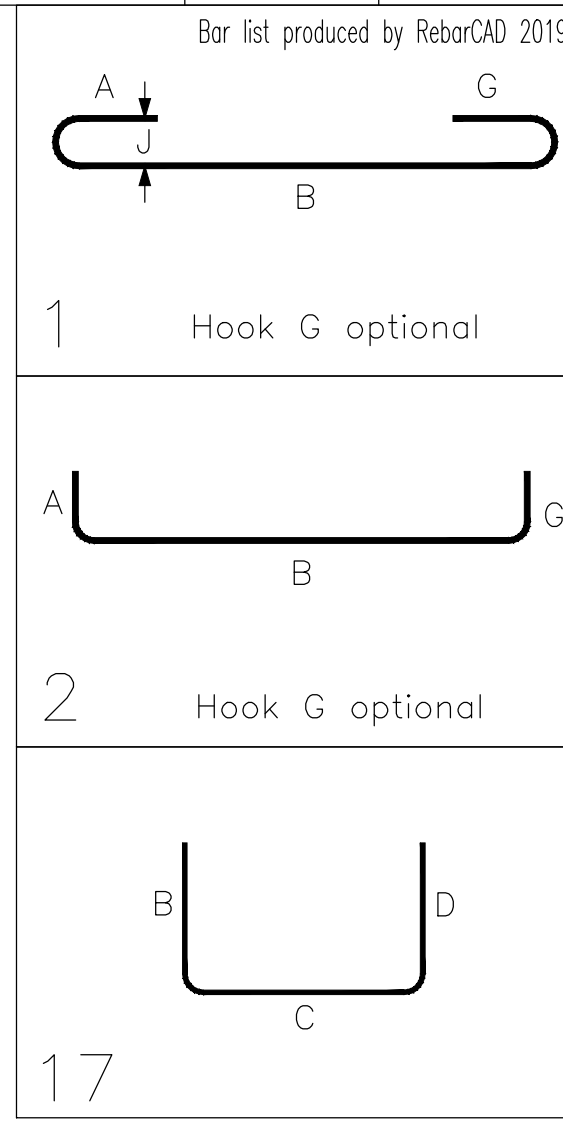

NOTES:
 1) F_c = 3,000 PSI
 2) ALL SLAB REINF. AT 12" O.C. U.O.N.
 3) ALL SLABS ARE 6" U.O.N.
 4) PROVIDE CLR. COVER TYP.: 1 1/2" MIN. U.O.N.
 5) ALL REINFORCEMENT SHALL CONFORM TO ASTM A633 GRADE 60
 6) MIN LAP:
 #3 = 1'-0"
 #5 = 2'-0"
 7) PROVIDE CHAIR BARS MID-DETH OF SLAB

	DATE	
DWG. TITLE: TRASH ENCLOSURE PLAN, WALLS REINFORCEMENT & TYP. DETAILS		
JOB:		
LOCATION: PRINCETON, TEXAS		
ARCHITECT:		
GC:	DWG. No.	
DRAWN BY:		