
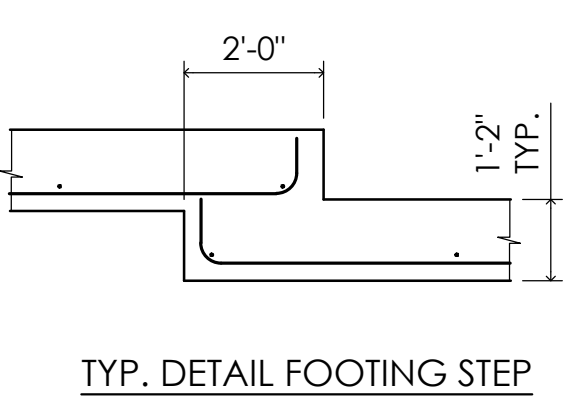
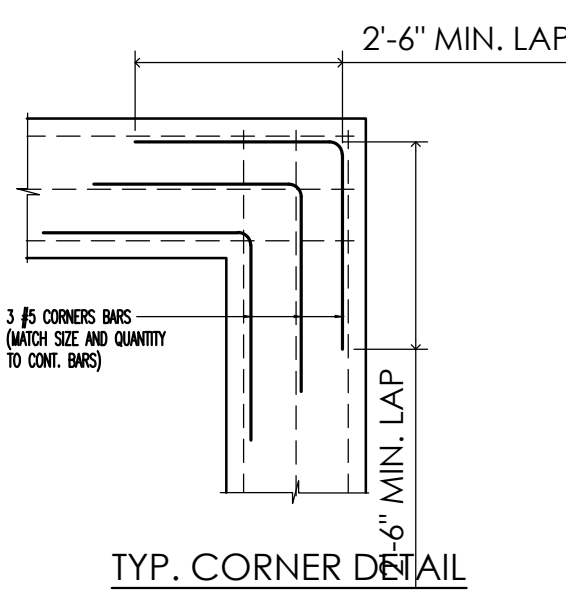
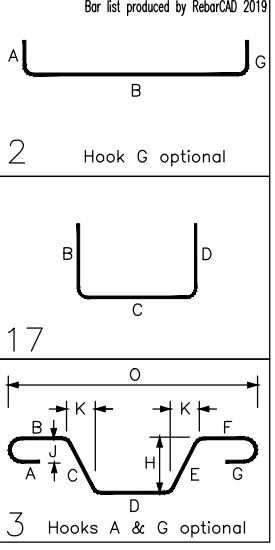


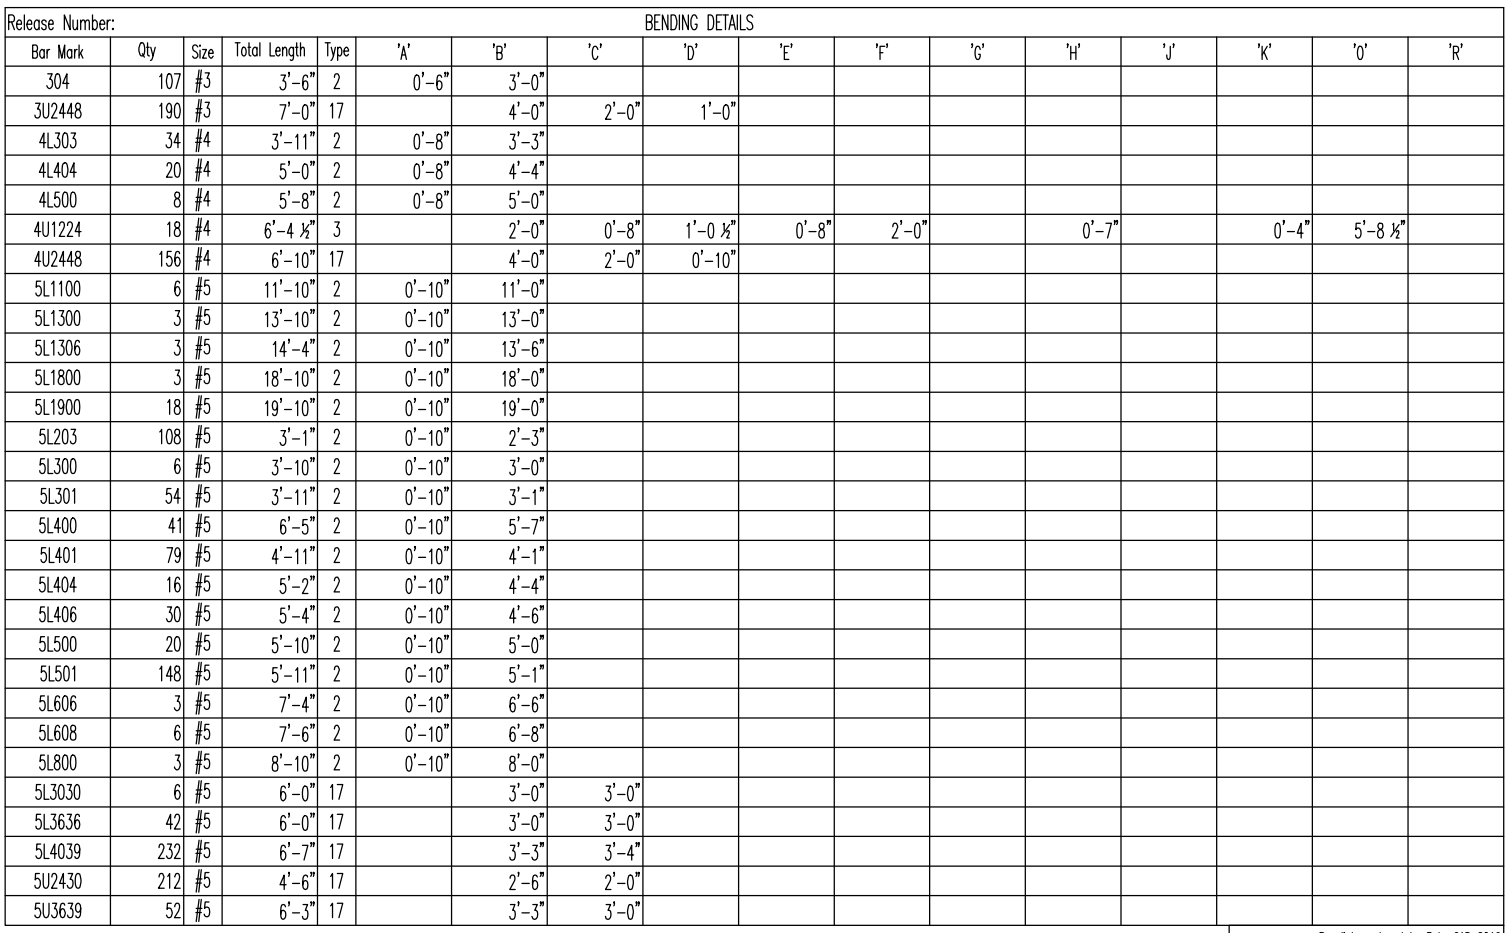

- NOTE:**
1. ALL CONCRETE SHALL BE $f'_c = 3,000$ PSI
 2. ALL REBAR SHALL CONFORM CONFORM TO ASTM A 615, GRADE 60
 3. WELDED WIRE FABRIC TO BE ASTM 185
 4. CONCRETE COVER:
FOOTINGS = 3" TYP.
OTHERS = 1 $\frac{1}{2}$ " TYP.

	DATE	
DWG. TITLE:		
FOUNDATION PLAN		
SPREAD FOOTING		
REINFORCEMENT		
JOB:	ATWOOD RANCH AND HOME	
LOCATION: CABOT, ARKANSAS		
ARCHITECT: DANIEL BARTLETT		
GC:	RABB CONSTRUCTION	DWG. No. R-01
DRAWN BY:		