


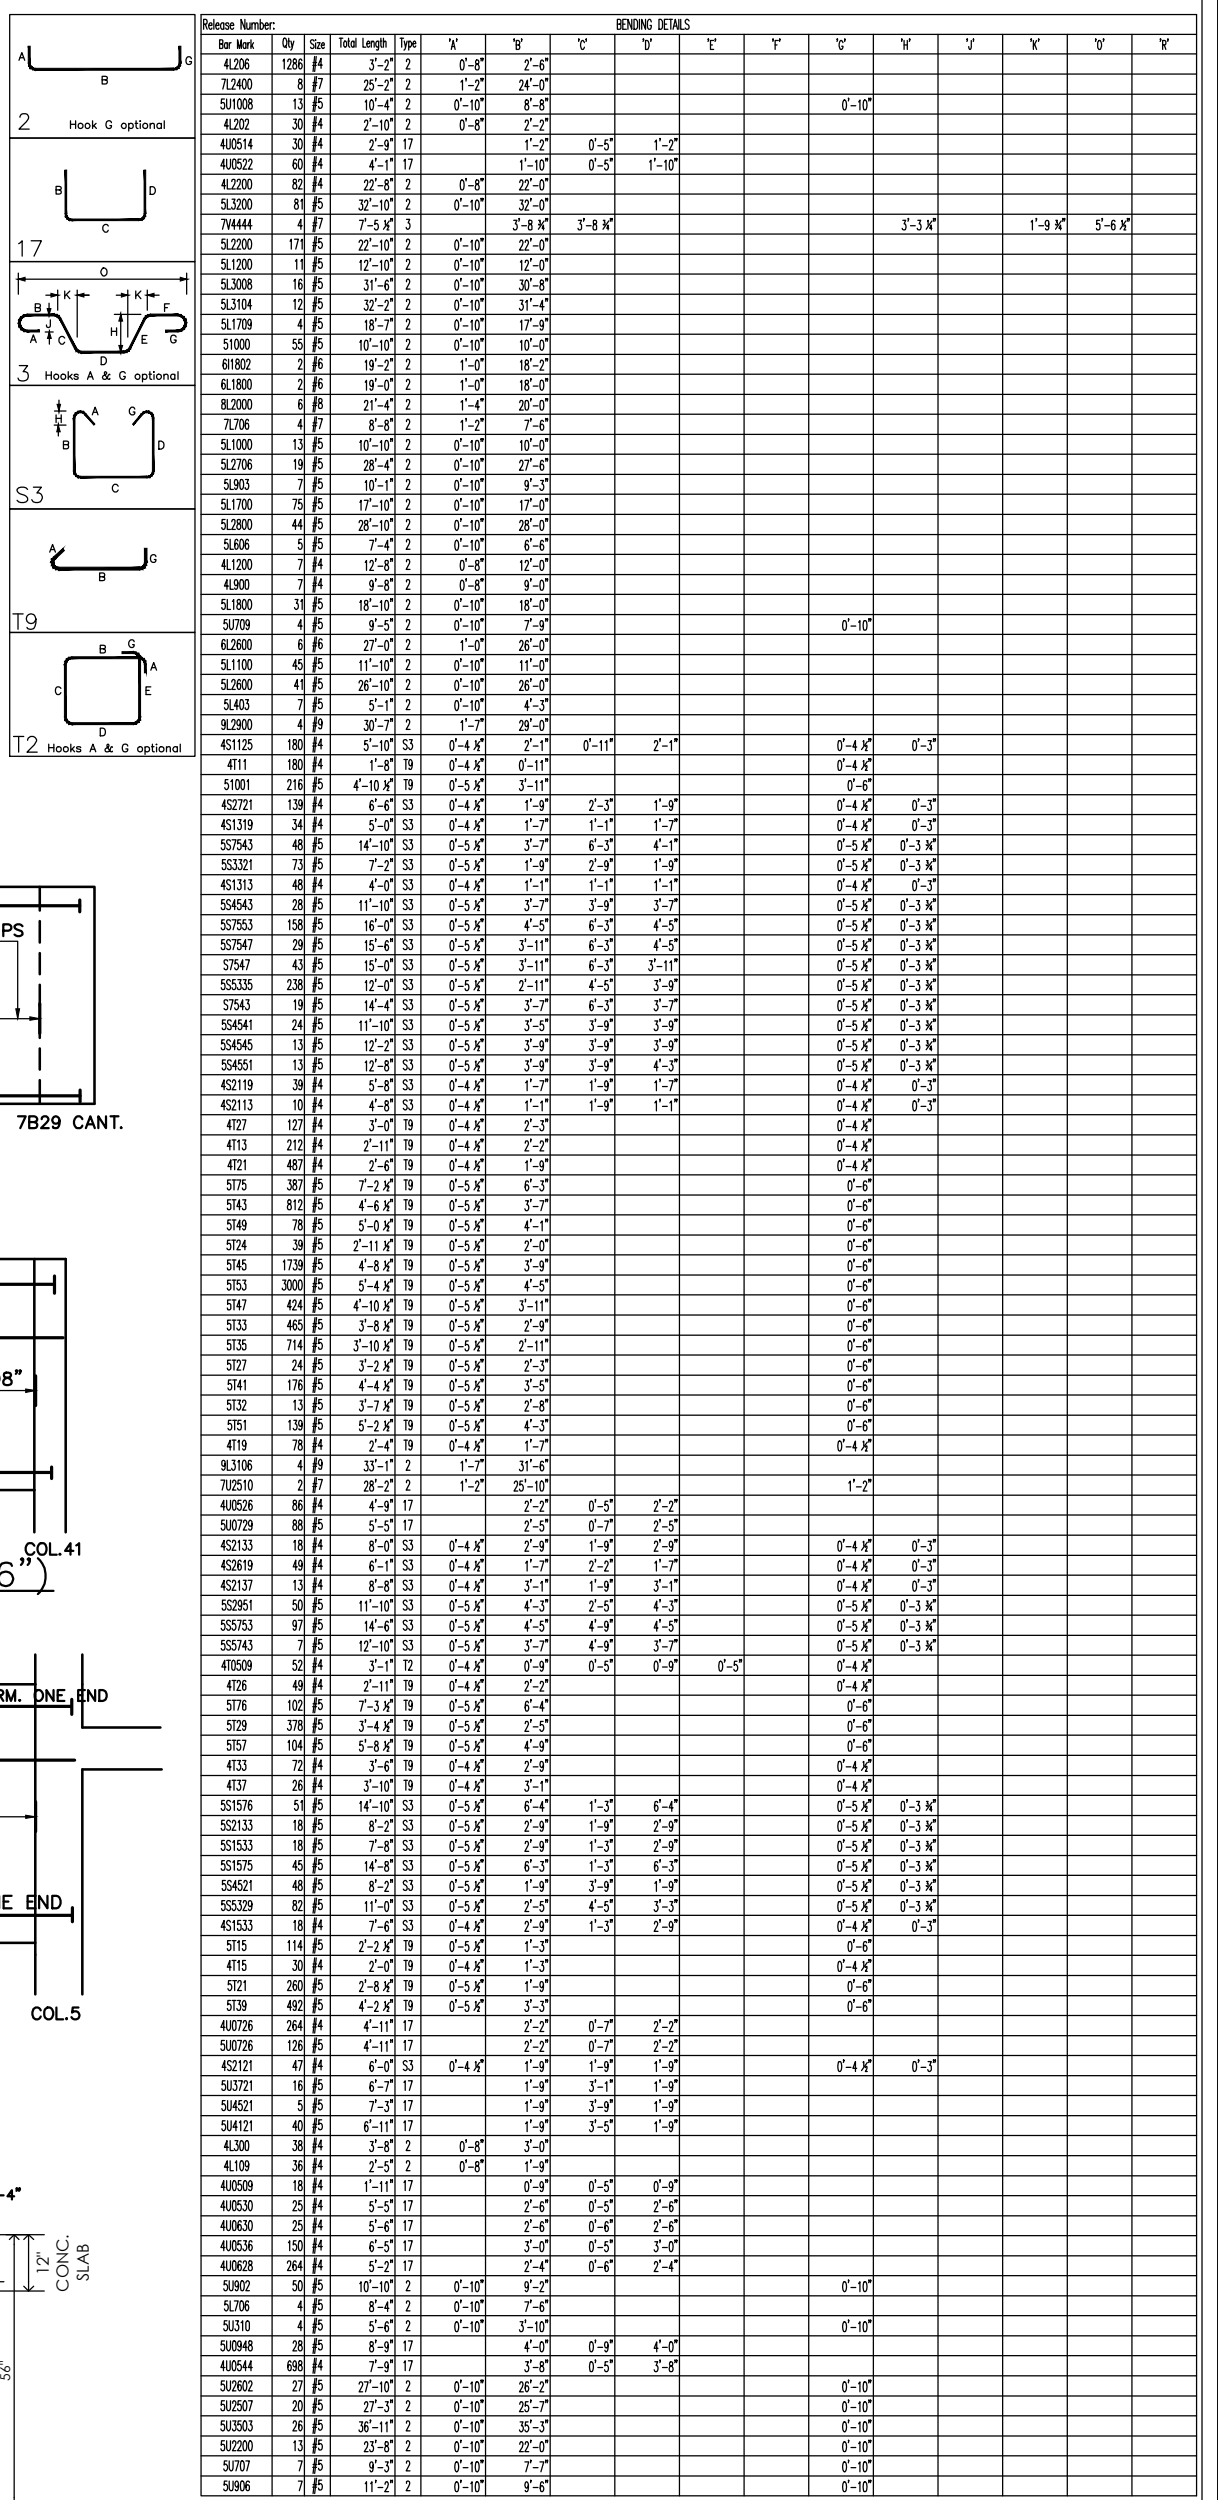

LAP SCHEDULE, GR. 60 (9800PSI)				
BAR SIZE	SLAB		BEAMS	
	BOIT.	TOP	BOIT.	TOP
#3	16"	16"	16"	16"
#4	16"	19"	16"	16"
#5	19"	24"	16"	19"
#6	25"	31"	17"	23"
#7	39"	51"	25"	33"
#8	48"	63"	30"	39"
#9	59"	76"	35"	46"
#10	69"	90"	41"	52"
#11	82"	107"	51"	67"

NOTES:
1) ALL BOTTOM REINF. AT 12" O.C. U.O.N.
ALL SLABS ARE 12" U.O.N.
PROVIDE 1 1/2" CLR. COVER FOR #5 BAR SMALLER,
2" FOR #6 LARGER BAR, TYP. T.&B
2) GRADE 60 FOR ALL BARS

* DENOTES ADD'L REINF.
& ALT. WITH MAIN BARS
* * DENOTES 2 ADD'L BETW.
2 MAIN BAR

TERMINATOR BARS ADDED TO REPLACE BEAM BOTTOM HOOKS

	DATE	SENT FOR

DWG. AREA:
7TH FLOOR SLAB
BEAMS AND BOTTOM BARS

JOB:

LOCATION: NEW YORK, NY

ARCHITECT:

ENGINEER:

DRAWN BY:

DWG. No.