


	For full, produced by ReberCA
T2 Hooks A & C optional	
2 Hooks A & C optional	2 Hook G optional

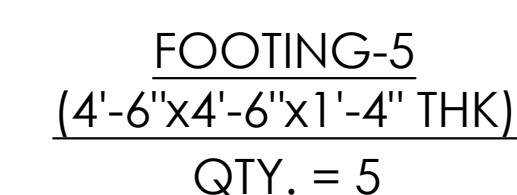

NOTE:

1. ALL CONCRETE SHALL BE $f'_c = 3,000$ PSI
2. ALL REBAR SHALL CONFORM CONFORM TO ASTM A 615, GRADE 60
3. WELDED WIRE FABRIC TO BE ASTM 185
4. CONCRETE COVER:
FOOTINGS = 3" TYP.
OTHERS = 1 $\frac{1}{2}$ " TYP.

	DATE	
DWG. TITLE: COLUMN FOOTING REINFORCEMENT AND TYPICAL DETAILS		
JOB:		
LOCATION: CABOT, ARKANSAS		
ARCHITECT:		
GC:		DWG. No. R-03
DRAWN BY:		